


**BASEMENT FLOOR PLAN**

SCALE: 1/8" = 1'-0"

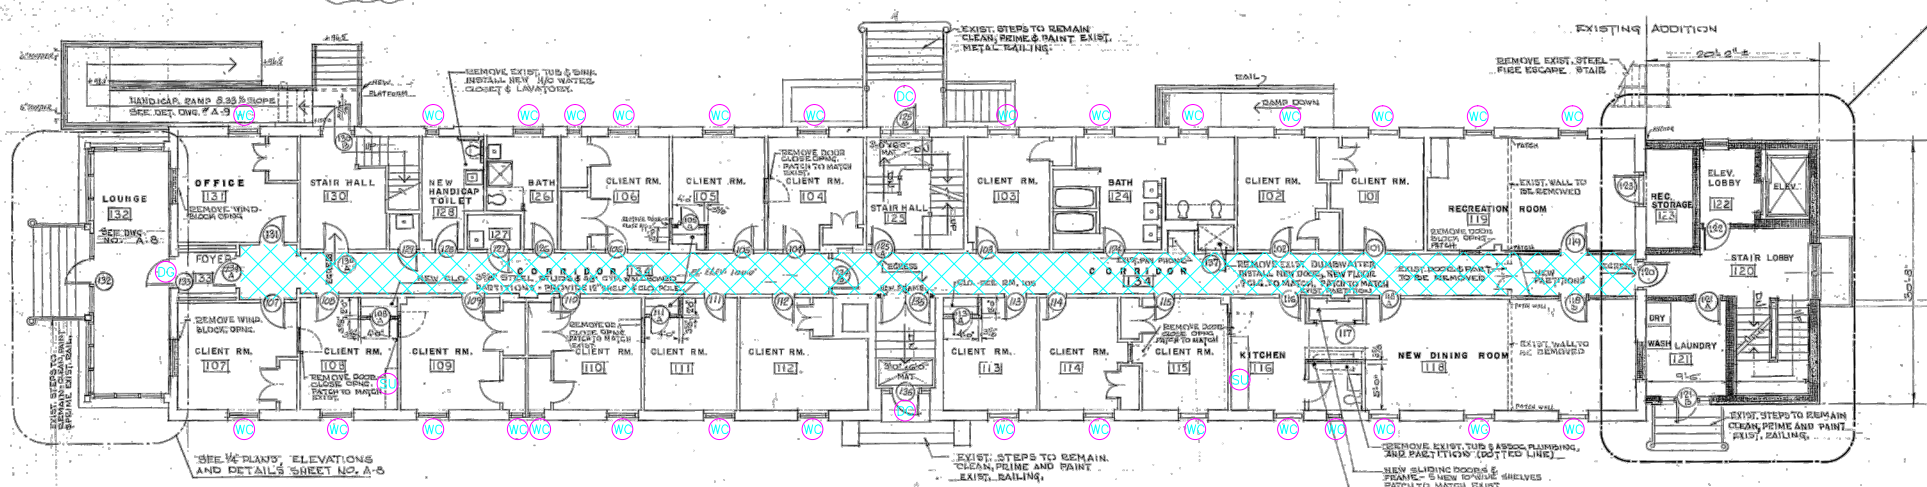

**FIRST FLOOR PLAN**

SCALE: 1/8" = 1'-0"

SAMPLE LEGEND	
SAMPLE IDENTIFICATION	SAMPLE RESULT
MATERIAL DESCRIPTION	PERCENTAGE AND TYPE OF ASBESTOS
AM	= AMOSITE
CA	= CARPET ADHESIVE
CB	= COVE BASE
CBA	= COVE BASE ADHESIVE
CFTA	= CERAMIC FLOOR TILE ADHESIVE
CFTG	= CERAMIC FLOOR TILE GROUT
CFTSC	= CERAMIC FLOOR TILE SETTING COMPOUND
CH	= CHRYSOTILE
CO	= COUNTERTOP
CT	= CEILING TILE
CWTA	= CERAMIC WALL TILE ADHESIVE
CWTG	= CERAMIC WALL TILE GROUT
CWTSC	= CERAMIC WALL TILE SETTING COMPOUND
DC	= DOOR CAULKING
DG	= DUCT GLAZING
DI	= DUCT INSULATION
DIA	= DUCT INSULATION ADHESIVE
DIW	= DUCT INSULATION WRAP
DS	= DUCT SEALANT
ECP	= END CAP PACKING
ECS	= END CAP SEALANT
EFIS	= EXTERIOR FINISH INSULATION SYSTEM
EJF	= EXPANSION JOINT FILLER
FC	= FLEX CONNECTOR
FP	= SPRAY-ON FIREPROOFING
FT	= FLOOR TILE
FTM	= FLOOR TILE MASTIC
GB	= GYPSUM BOARD
GD	= GLUE DAUB
JC	= JOINT COMPOUND
LI	= LINOLEUM
LIA	= LINOLEUM ADHESIVE
LV	= LEVELING COMPOUND
MA	= MISCELLANEOUS ADHESIVE
MC	= MISCELLANEOUS CAULKING
MM	= MISCELLANEOUS MATERIAL
N	= NEGATIVE
NA	= NOT ANALYZED
NAD	= NO ASBESTOS DETECTED
NAPS	= NOT ANALYZED POSITIVE STOP
P	= POSITIVE
PFI	= PIPE FITTING INSULATION
PI	= PIPE INSULATION
PIA	= PIPE INSULATION ADHESIVE
PLCB	= PLASTER CEILING BASE COAT
PLCS	= PLASTER CEILING SKIM COAT
PLWB	= PLASTER WALL BASE COAT
PLWS	= PLASTER WALL SKIM COAT
PM	= PIPE MASTIC
PS	= PENETRATION SEALANT
PW	= PIPE WRAP
RC	= ROOF CEMENT
RF	= ROOF FLASHING
RP	= ROOF PAPER
SCT	= SUSPENDED CEILING TILE
SS	= SINK SEALANT
SU	= SINK UNDERCOAT
T	= TRANSITE
TC	= TEXTURED COATING
TR	= TRACE
VW	= VALVE WRAP
WC	= WINDOW CAULKING
WG	= WINDOW GLAZING
WP	= WATERPROOFING
WT	= WALL TILE

SYMBOL	MATERIAL DESCRIPTION
	ACM FLOOR TILE ONLY
	ACM SHEET FLOORING
	ACM SINK UNDERCOAT
	ACM PIPE INSULATION
	ACM PIPE FITTING INSULATION
	ACM BREACHING INSULATION
	ACM TANK INSULATION
	ACM BOILER INSULATION
	ACM WINDOW CAULK
	ACM DOOR CAULK
	ACM DOOR WINDOW GLAZING

**NOTES**

1. NOT ALL SYMBOLS IN THE LEGEND ARE USED IN THIS DRAWING.
2. BLACK ROOFING CEMENT UNDER SLATE SHINGLES AT ROOF AND DORMERS IS ACM.
3. ACM PIPE FITTING CEMENT AND PIPE INSULATION PRESENT INSIDE WET WALLS, CHASES.

drawing title		STATE OF CONNECTICUT	
ACM LOCATIONS		DEPARTMENT OF ADMINISTRATIVE SERVICES	
BASEMENT AND FIRST FLOOR PLAN		DIVISION OF CONSTRUCTION SERVICES	
REVISIONS			
mark	date	description	
DRAWING PREPARED BY		date	
		12/24/14	
project		SCALE	
BUILDING INSPECTION		1/4" = 1'	
NURSE'S BUILDING		DRAWN BY	
SEASIDE REGIONAL CENTER		BLS	
WATERFORD, CONNECTICUT		APPROVED BY	
		EF	
drawing no.		ASB-1	
CAD no.		project no.	
		61.22573.0020 TASK 20069	